


# CERTIFIED TESTING LABORATORIES

Architectural Division • 7252 Narcoossee Rd. • Orlando, FL 32822  
(407) 384-7744 • Fax (407) 384-7751  
Web Site: www.ctlarch.com  
E-mail: ctlarch.com

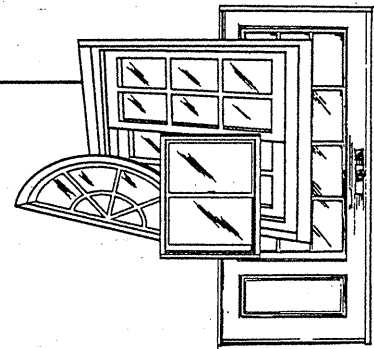

Report Number: CTLA-639W-1  
Report Date December 18, 2000

## STRUCTURAL PERFORMANCE TEST REPORT

**Client:** Specialty Window of Florida  
690 Heinberg Street  
Pensacola, Florida 32501

**Product Type and Series:** Series 1400 Vinyl Flange Frame Casement Window C-R 50 (30" x 66") (Downsized)

**Test Specifications:** AAMA/NWWDA 101/1.S. 2-97 "Voluntary Specification for Aluminum Vinyl (PVC) and Wood Window and Glass Door".

### Test Specimen

**Frame:** The vinyl flange frame measured 30" x 66" overall, miter and welded corner construction.

**Configuration:** Single Casement.

**Ventilator:** Operable vent measured 28.5" x 64.5" overall, miter and welded corner construction.

**Weather Stripping:** Main Frame: Two (2) continuous strips of bulb vinyl .300dia., located in the two (2) interior pockets of the frame.

Vent: One (1) continuous strips of vinyl with .250" fin. molded into exterior leg on vent.

### Hardware & Location

<u>Quantity</u>	<u>Description</u>	<u>Location</u>
1	E'lan Roto Operators	One (1) in each vent bottom rail
2	Ashland 14" adjustable track	One (1) in head and sill of main frame vents
2	Ashland 14" stainless steel hinges	One (1) in each vent top and bottom rails
3	Snubbers	Three (3) in each main frame jamb 18" from each end and mid-span
1	63" Lock bar with 3 point locking	One (1) in each vent lockstile
3	lock bar keepers	Three (3) in each main frame jamb 18" from each end and mid-span

**Glazing:** Insulated unit, consisting of two (2) lites of 1/8" annealed glass with .625" air space. Interior dry glazed, captured with a vinyl snap in glazing stops.

**Sealant:** Silicone caulk was used on perimeter of main frame

**Weepholes:** N/A

**Reinforcement:** N/A

**Additional Description:** N/A

**Screen:** N/A

**Installation:** Fourteen (14) # 10 x 3" phillips pan head were used to secure the specimen to the wooden test buck. Two (2) in the head and sill located 6" from each end . Five (5) in each jamb located 6" from each end 18" on center thereafter.

**Surface Finish:** White

**Performance Test Results**

<u>Paragraph No</u>	<u>Title of Test</u>	<u>Method</u>	<u>Measured</u>	<u>Allowed</u>
*2.1.2	Air Infiltration @ 6.24 psf The tested specimen exceeds the performance levels specified in AAMA/NWWDA 101/1.S. 2-97 for Air Infiltration.	ASTM E283-91	.12 cfm/ft <sup>2</sup>	.3 cfm/ft <sup>2</sup>
*2.1.3/4.3	Water Resistance 5.0 gph/ft <sup>2</sup> WTP=12PSF	ASTM E547-93 Four (4), five minute cycles ASTM E331-93 Fifteen (15)minute duration	No Entry  No Entry	No Entry  No Entry
2.1.4.2/4.4.2	Uniform Load Structural Permanent Deformation @ 75 psf Positive @ 75 psf Negative	ASTM E330-90 Ten (10) seconds loads	.011" .012"	.264" .264"
*2.1.7	Corner Weld Test	AAMA 101/1.S.2-97	Passed	Passed
*2.1.8	Force Entry Resistance Test A Test B Test C Test D.E.F Test G	AAMA 1302.5-76	0" 0" 0" 0" 0"	1/2" 1/2" 1/2" 1/2" 1/2"
*2.2.5.6.1	Vertical Deflection Test	AAMA 101/IS2-97		PASSED
*2.2.5.6.2	Hardware Load Test	AAMA101/IS2-97		PASSED

\*Reference CTLA-639W

**Test Date:** November 28, 2000

**Test Completion Date :** November 28, 2000

**Remarks:** Detailed drawings were available for laboratory records and comparison to the test specimen at the time of this report. A copy of this report along with representative sections of the test specimen will be retained by CTL for a period of four (4) years. The results obtained apply only to the specimen tested.

This test report does not constitute certification of this product, but only that the above test results were obtained using the designated test methods and they indicate compliance with the performance requirements (paragraphs as listed) of the above referenced specifications.

Certified Testing Laboratories assumes that all information provided by the clients is accurate and that the physical and chemical properties of the components as stated by the manufacture.

Certified Testing Laboratories, Inc.

Christopher Bennett  
Lab Manager  
Architectural Division

cc NAMI (2)  
Specialty (2)  
Ramesh Patel P.E.  
File

Ramesh Patel P.E.

12/22/00