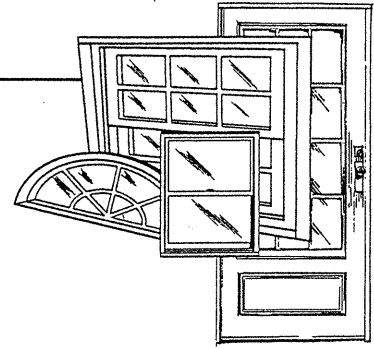


CERTIFIED TESTING LABORATORIES

Architectural Division • 7252 Narcoossee Rd. • Orlando, FL 32822
(407) 384-7744 • Fax (407) 384-7751
Web Site: www.ctlarch.com
E-mail: ctlarch.com



Report Number: CTLA-829W-3
Report Date: March 27, 2002

STRUCTURAL PERFORMANCE TEST REPORT

Client: Specialty Window of Florida
690 Heinberg Street
Pensacola, Florida 32501

Product Type and Series: Configuration # 2 3" Aluminum Structural Mull.

Test Specifications: ASTM E 330-90 Standard Test Method for Structural Performance Exterior Windows, Curtain Walls, and Doors by Uniform Static Air Pressure Difference.

Test Specimen

Name: The mullion were tested as stand alone . The 2" x 12" PT wooden test buck measured 72" x 96" the vertical mullion measured 96". The vertical mullion was attached to wooden buck with a extruded aluminum clips, the clips were attached to the wooden test buck with two (2) # 10 x 2" phillips pan head fasteners. The mull clip was free floating in the aluminum mull.

Glazing: N/A

Sealant: N/A

Weepholes: N/A

Reinforcement: None

Additional Description: The mullion were tested in a 2" x 12" PT test buck . To enable us to perform this test there were two (2) 2"x 4" panels with plywood free floating in the opening.

Screen: N/A

Installation: N/A

Surface Finish: White

[Handwritten Signature]
4/4/02

Performance Test Results

<u>Paragraph No</u>	<u>Title of Test</u>	<u>Method</u>	<u>Measured</u>	<u>Allowed</u>	<u>Measured</u>	<u>Allowed</u>
2.1.4.2/4.4.2	Uniform Load Structural Permanent Deformation @ 82.5 psf Positive @ 82.5 psf Negative	ASTM E330-90 Ten (10) seconds loads	Def Vertical	Def mullion	Set .006" .002"	Set .384" .384"

Deflection and Set reading taken at mid-span of mullion

Test Date: February 7, 2002

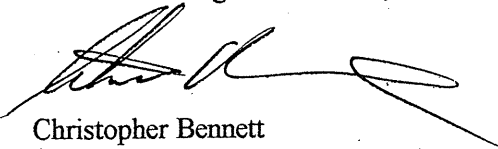
Test Completion Date: February 7, 2002

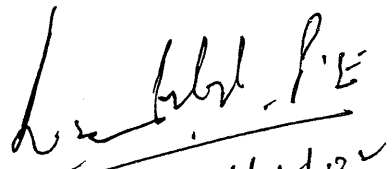
Remarks: Detailed drawings were available for laboratory records and comparison to the test specimen at the time of this report. A copy of this report along with representative sections of the test specimen will be retained by CTL for a period of four (4) years. The results obtained apply only to the specimen tested.

This test report does not constitute certification of this product, but only that the above test results were obtained using the designated test methods and they indicate compliance with the performance requirements (paragraphs as listed) of the above referenced specifications.

Certified Testing Laboratories assumes that all information provided by the clients is accurate and that the physical and chemical properties of the components as stated by the manufacture.

Certified Testing Laboratories, Inc.


Christopher Bennett
Lab Manager
Architectural Division


Ramesh Patel P.E.
4/2/02

cc ALI (2)
Specialty (2)
Ramesh Patel P.E.
File