



SECTION A-A

TAPCON LOCATION CHART		
WINDOW SIZE	QUANTITY IN HEAD & SILL	QUANTITY IN EACH JAMB
	UP TO 70 PSF	UP TO 70 PSF
36 X 37	A,B,C,D	M,N
36 X 43	A,B,C,D	M,N
36 X 49	A,B,C,D	K,J,M,N,O,P
36 X 52	A,B,C,D	K,L,M,N,O,P
42 X 37	A,B,C,D	M,N
42 X 43	A,B,C,D	M,N
42 X 49	A,B,C,D	K,L,M,N,O,P
42 X 52	A,B,C,D	K,L,M,N,O,P
48 X 37	A,B,C,D	M,N
48 X 43	A,B,C,D	M,N
48 X 49	A,B,C,D	K,L,M,N,O,P
48 X 52	A,B,C,D	K,L,M,N,O,P
54 X 37	A,B,C,D	M,N
54 X 43	A,B,C,D	M,N
54 X 49	A,B,C,D	K,J,M,N,O,P
54 X 52	A,B,C,D	K,L,M,N,O,P
60 X 37	A,B,C,D	M,N
60 X 43	A,B,C,D	M,N
60 X 49	A,B,C,D	K,L,M,N,O,P
60 X 52	A,B,C,D	K,L,M,N,O,P
66 X 37	A,B,C,D	M,N
66 X 43	A,B,C,D	M,N
66 X 49	A,B,C,D	K,L,M,N,O,P
66 X 52	A,B,C,D	K,L,M,N,O,P
72 X 37	A,B,C,D	M,N
72 X 43	A,B,C,D	M,N
72 X 49	A,B,C,D	K,J,M,N,O,P
72 X 52	A,B,C,D	K,L,M,N,O,P
78 X 37	A,B,C,D	M,N
78 X 43	A,B,C,D	M,N
78 X 49	A,B,C,D	K,L,M,N,O,P
78 X 52	A,B,C,D	K,L,M,N,O,P
84 X 37	A,B,C,D	M,N
84 X 43	A,B,C,D	M,N
84 X 49	A,B,C,D	K,L,M,N,O,P
84 X 52	A,B,C,D	K,L,M,N,O,P

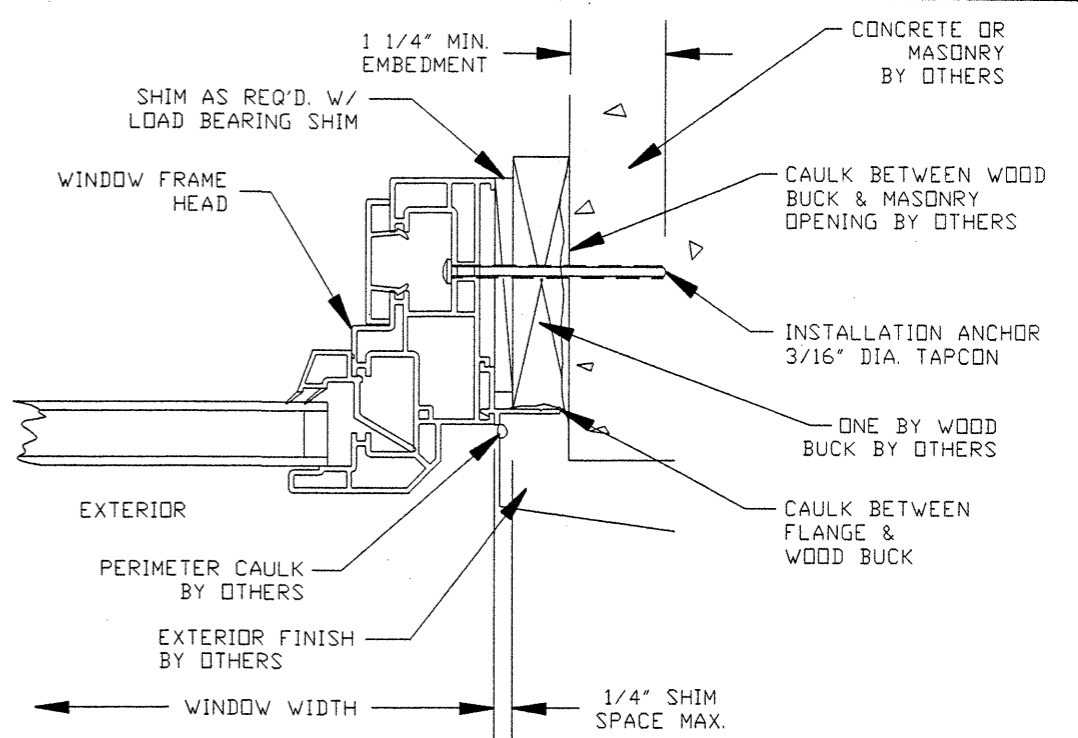

SECTION B-B

- NOTES:
- 1) SHIM AS REQ'D. AT EACH INSTALLATION ANCHOR W/ LOAD BEARING SHIM. MAX. ALLOWABLE SHIM STACK TO BE 1/4". USE SHIMS WHERE SPACE GREATER THAN 1/16" IS PRESENT.
  - 2) WINDOW FRAME MATERIAL: POLY VINYL CHLORIDE.
  - 3) 3/16" DIA. TAPCON SCREW ANCHOR MUST BE OF SUFFICIENT LTH. TO ACHIEVE MIN. EMBEDMENT OF 1-1/4" INTO MASONRY OR CONCRETE.
  - 4) LETTER DESIGNATIONS ON THE CONCRETE SCREW ANCHOR LOCATION CHART INDICATE WHERE CONCRETE SCREW ANCHORS ARE TO BE INSTALLED WHEN USING THE EXTERIOR ELEVATION AS A KEY.
  - 5) NOT ALL INSTALLATION HOLES FOR ANCHORS SHOWN ON ELEVATION ARE APPLIED BY FACTORY IN ALL SIZES. ALL FACTORY APPLIED HOLES NOT DESIGNATED FOR CONCRETE SCREW ANCHOR SHOULD BE FILLED WITH #8 SCREWS OF SUFFICIENT LTH. TO PROVIDE MIN. 5/8 IN. EMBEDMENT INTO WOOD BUCK. INSTALLATION ANCHORS, WHETHER TAPCONS OR #8 SCREWS TO BE 6" FROM END MAX. AND 24" O.C. MAX.
  - 6) CAULK BEHIND WINDOW FLANGE WITH LATEX CAULK.
  - 7) USE LATEX CAULK FOR PERIMETER SEAL AROUND EXTERIOR OF WINDOW FLANGE BY OTHERS.
  - 8) IF EXACT WINDOW SIZE IS NOT LISTED IN ANCHOR CHART, USE ANCHOR QUANTITY LISTED WITH NEXT LARGER SIZE.
  - 9) GLASS THICKNESS MAY VARY PER THE REQUIREMENTS OF ASTM E1300 GLASS CHARTS.
  - 10) INSTALLATION AS STATED HEREIN COMPLIES WITH THE FLORIDA BUILDING CODE. DESIGN PRESSURE CAPACITY OF WINDOW & INSTALLATION IS 70.0 PSF.

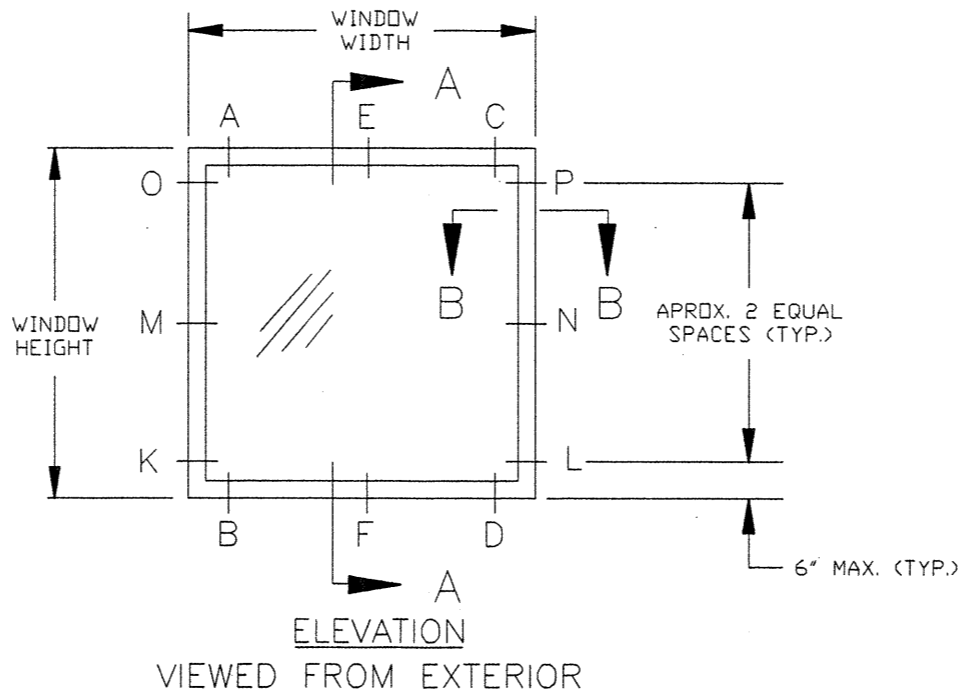

ELEVATION VIEWED FROM EXTERIOR

WINDOW PROS		
TITLE: PICTURE WINDOW INSTALLATION MASONRY OPENING WITH ONE BY BUCK		
ENGINEER: MANUEL MARTINEZ	DRN: BB	DATE: 3/13/02
DISCIPLINE: CIVIL	SCALE: N.T.S.	DWG. NO: RPLUS0010
FL. REG. NO: 47182	REV. LETTER:	SHEET: 1 OF 2